



Product designation				Enclosed changeover switch
Product type designation				GAZ
Number of poles		Nr.	3	
Operating voltage type				AC
Contact characteristics				
IEC Conventional free air thermal current I <sub>th</sub>		A	40	
Rated insulation voltage U <sub>i</sub> IEC/EN		V	1000	
Rated impulse withstand voltage U <sub>imp</sub>		kV	8	
Operating current I <sub>e</sub>				
AC21A				
	400V	A	40	
	500V	A	40	
	690V	A	40	
AC22A				
	400V	A	40	
	500V	A	40	
	690V	A	40	
AC23A				
	400V	A	40	
	500V	A	25	
	690V	A	25	
Power dissipation per pole max		W	1	
Rated operational power AC23A				
	400V	kW	18.5	
	690V	kW	22	
Conditional short-circuit current (rms)		kA	10	
Short-circuit protection with fuse		Class/A	gG40	
Making capacity AC23A 400V		A	400	
Breaking capacity AC23A 400V		A	320	
Mechanical life		cycles	100000	
Electrical life AC21A		cycles	100000	
Mechanical features				
Operating position				
	normal allowable			Vertical plan Any
Terminals				
	type			Pillar
	width	mm	5.6	
	height	mm	6.5	
	screw		M4	
	tool		Phillips 2	
Tightening torque for terminals				
	min	Nm	1.8	

max	Nm	2
min	lbin	16
max	lbin	18

#### Conductor section

IEC min	mm <sup>2</sup>	0.75
IEC max	mm <sup>2</sup>	16
AWG/kcmil min		18
AWG/kcmil max		6

#### Ambient conditions

##### Operating temperature

min	°C	-25
max	°C	+55

##### Storage temperature

min	°C	-40
max	°C	+70

##### Max altitude

m	3000
---	------




#### Resistance & Protection

Frontal IP degree	IP65
-------------------	------


IP degree of protection	IP65
-------------------------	------

Pollution degree	3
------------------	---

#### Dimensions

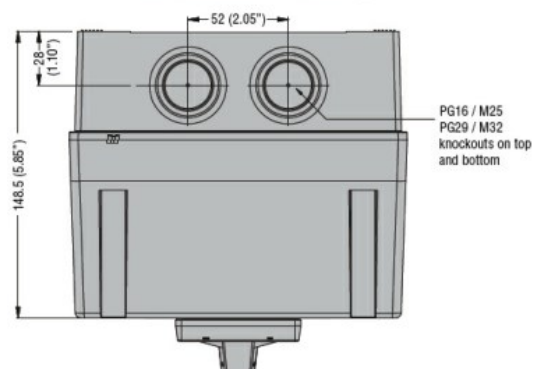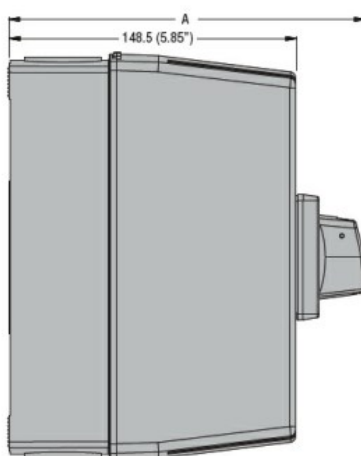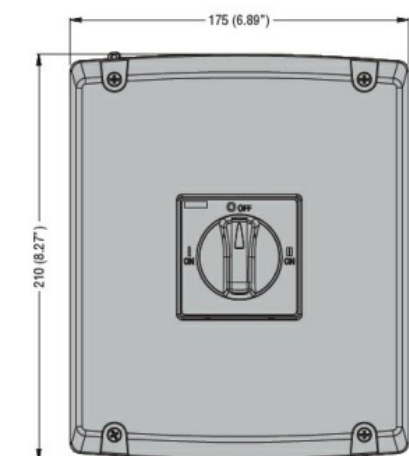


##### Drilling

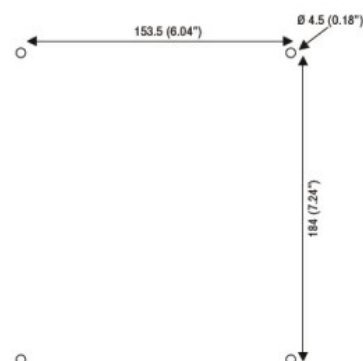

Type	A
GAZ032 D...	171.5 (6.75")
GAZ040 D...	171.5 (6.75")
GAZ025 ET...	183.5 (7.22")
GAZ063 SAET...	183.5 (7.22")

#### Wiring diagrams

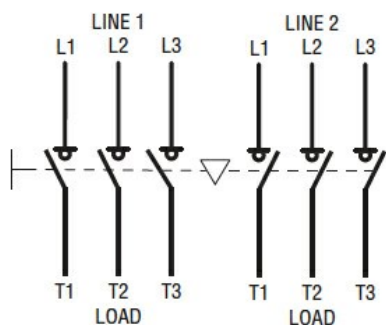

## Certifications and compliance

### Compliance

IEC/EN 60947-1  
IEC/EN 60947-3  
UL 508 e CSA C22.2 n°14

### Certifications

cCSAus  
EAC

## ETIM classification

ETIM 8.0

EC000216 -  
Switch  
disconnecter