





| Product designation<br>Product type designation |     |    | Empty<br>enclosures<br>MOPA |
|---|-----|----|-----------------------------|
| Electrical features                             |     |    |                             |
| Maximum operating current (≤440V)               |     | А  | 12                          |
| Components                                      |     |    |                             |
| Contactor standard supplied                     |     |    | BG06, BG09,<br>BG12         |
| Thermal relay to purchase separately            |     |    | RF9                         |
| Mechanical features                             |     |    |                             |
| Weight  |     | g  | 490                         |
| Ambient conditions                              |     |    |                             |
| Operating temperature                           |     |    |                             |
|   | min | °C | -25                         |
|   | max | °C | +60                         |
| Storage temperature                             |     |    |                             |
|   | min | °C | -40                         |
|   | max | °C | +70                         |
| Resistance & Protection                         |     |    |                             |
| Frontal IP degree                               |     |    | IP65                        |
| Dimensions                                      |     |    |                             |



## **MOPA** MOTORSTARTER ZUBEHÖR LEERGEHÄUSE FÜR MOTORSTARTER MIT START UND STOP TASTE

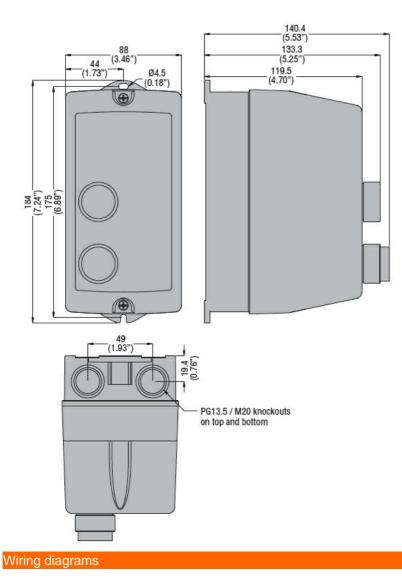

ENERGY AND AUTOMATION

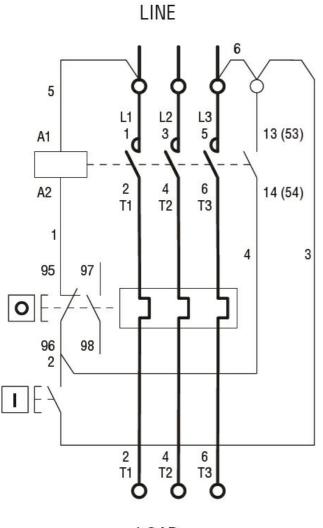



## I = Start; O = Stop/Reset

| Certifications and  | compliance       |   |
|---------------------|------------------|---|
| Compliance          |                  |   |
|                     | CSA C22.2 n° 14  |   |
|                     | IEC/EN 60947-1   |   |
|                     | IEC/EN 60947-4-1 |   |
|                     | UL508            |   |
| Certificates        |                  |   |
|                     | cULus            |   |
| ETIM classification | n                |   |
| ETIM 8.0            |                  | EC000200 -<br>Enclosure for<br>control circuit<br>devices |
|                     |                  |   |